

The fire safety instructions box



Edition: 2 from 04.07.2018
Supercedes the edition: 1 from 04.09.2017

EN

1. Application.

The cabinet is designed for storage of fire safety instructions in accordance with the Regulation of the Minister of Interior and Administration of the Republic of Poland on fire protection of buildings, other building facilities and sites of 07 06 2010 (Journal of Laws No. 109, item 719).

The enclosure design allows multiple opening without the need for a quick replacement because the window is made of plastic instead of glass.

The set includes a photoluminescent sticker labeled "FIRE SAFETY INSTRUCTIONS". Due to the fact that the sticker is not factory-fitted on the cabinet surface, this product can also be used as a cabinet for other documents such as VAS documentation, building plans, etc.

The enclosure is fitted with a Tamper switch which activates when the case is opened or the window is pushed in. When connected to the master system, it supervises both the opening of the enclosure and pushing in the window.

The enclosure is fitted with pre-embossed openings for cable gland for a tamper cable in the rear wall and a porcelain screw connection for its connection.

Table 1. Components of the enclosure.

Component No.	Description
[1]	Key window
[2]	Tamper switch
[3]	The oval mounting holes in the rear wall for mounting to the ground 9x14mm
[4]	Pre-embossed openings for cable glands in the rear wall
[5]	Porcelain screw connection in the cabinet

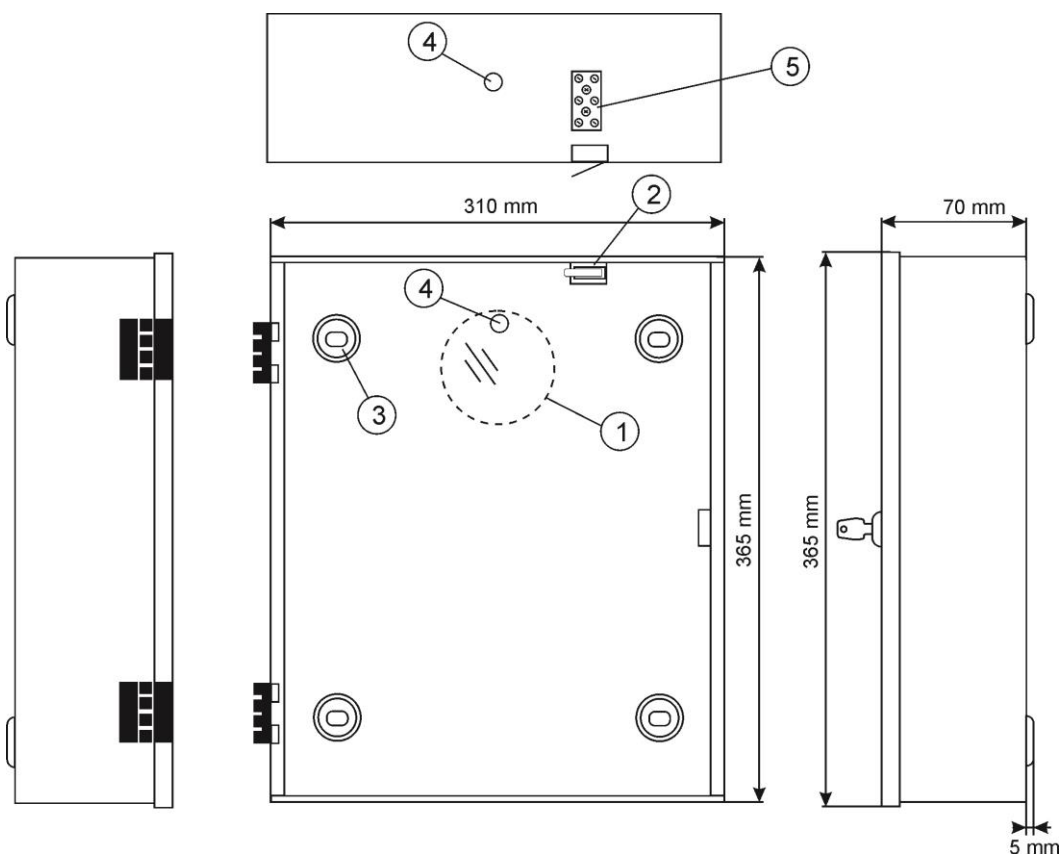


Fig.1. The view of the fire safety instructions box.

Table 2. Technical parameters.

Finish	Finish: DC01 steel plate, thickness 1,0mm, corrosion protection, color RAL 3001 - red
Dimensions of storage space for documents	285 x 330 x 40 [mm +/-2mm] (WxHxD)
External dimensions- without hinges and lock	310 x 365 x 70+5 [mm +/-2mm] (WxHxD)
Mounting	4 x ellipsoidal screw 9 x 14 mm
Net/gross weight:	3,00 kg /3,20 kg [+/-0,1 kg]
Application:	Indoor
Closing	Lock – the same code (9081)
Protection Class	IP30
Cable clamps	Max. 6 mm ²
Cable gland cross-section	10mm
Warranty	2 year from the production date

2. Installation.

The fire safety instructions box shall be mounted in confined spaces with normal air humidity (RH=90% max. without condensation) and the temperature from -10°C to +40°C.

It is designed for installation in a building, in a place accessible for rescue teams.

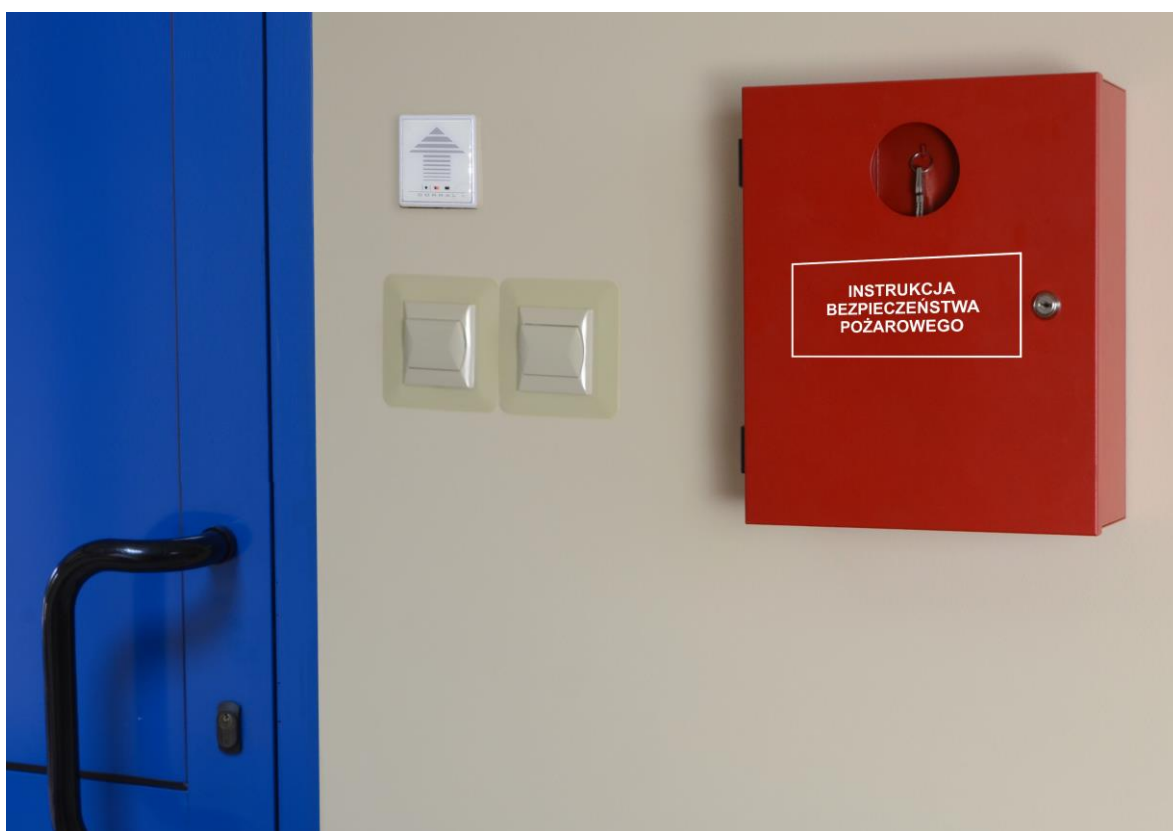


Fig.2. Installation example of the fire safety instructions box.

WEEE PARKING

According to the EU WEE Directive – It is required not to dispose of electric or electronic waste as unsorted municipal waste and to collect such WEEE separately.

Pulsar

Siedlec 150, 32-744 Łapczyca, Polska
 Tel. (+48) 14-610-19-40, Fax. (+48) 14-610-19-50
 e-mail: biuro@pulsar.pl, sales@pulsar.pl
 http:// www.pulsar.pl, www.zasilacze.pl